




## TapWatch® Site Health Report

<b>Customer:</b>	Sample Utility Billing Company
<b>Property:</b>	Sample Property Company
<b>Property Address</b>	123 Main St, Town, State
<b>Date:</b>	1/14/2020





Work Order:	
<b>Step 1</b>	Service inactive repeaters to ensure they are powered, functional and installed per installation instructions.
<b>Step 2</b>	Check device status to determine if repeater service addresses inactive transmitters and abnormal check ins.
<b>Step 3</b>	Service tampered units to ensure they are powered, functional and installed per installation instructions.
<b>Step 4</b>	Optional: Use the EN7017 survey kit and app or EN4016SK survey receiver to ensure adequate repeater coverage and/or that the site is not over populated with repeaters.

Gateway Health	
<b>Total Uptime:</b>	159.17 Days
<b>Firmware Version:</b>	1.3.1.172
<b>Firmware Current:</b>	Yes
<b>Last Sync:</b>	1/14/2020, 03:01:31 PM

Repeaters	Status
<b>Active:</b>	4
<b>Inactive:</b>	2

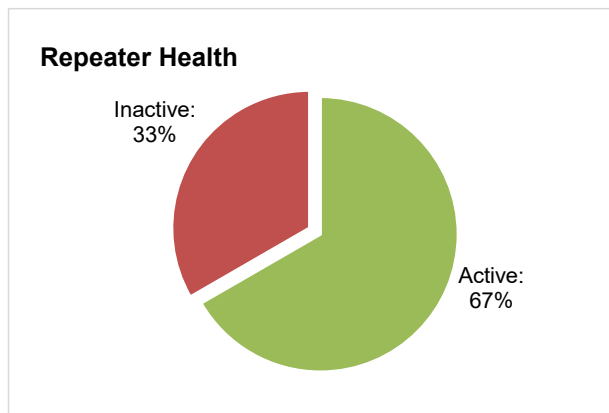

Transmitters	Status
<b>Active:</b>	288
<b>Inactive:</b>	6
<b>Secure:</b>	244
<b>Tamper:</b>	50
<b>Normal Check-In:</b>	230
<b>Abnormal Check-Ins:</b>	64
<b>Battery Normal:</b>	294
<b>Low Battery:</b>	0

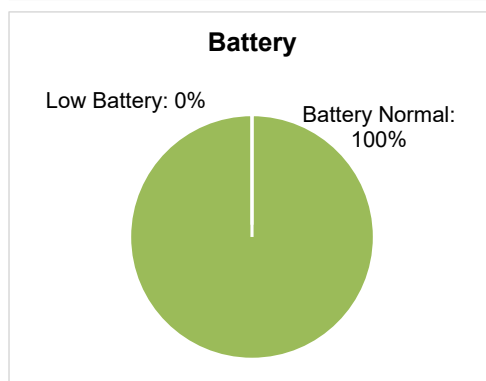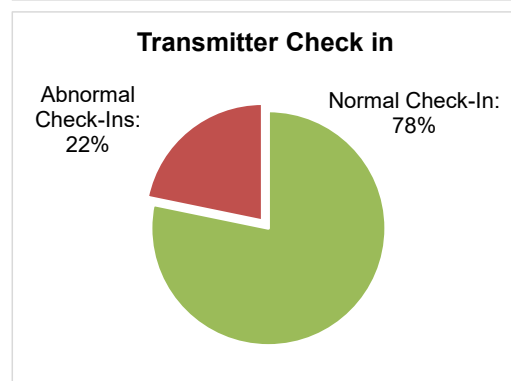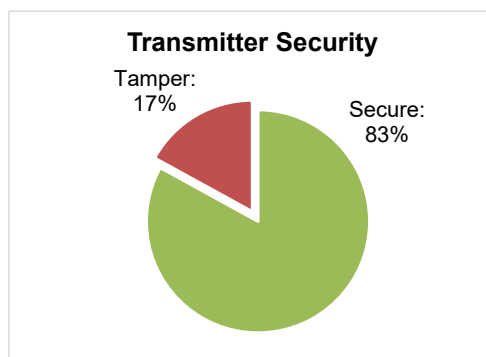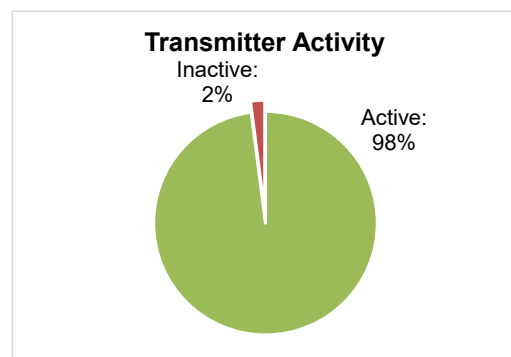

## Breakdown by Device

Type	Building Name	Unit Name	Location	TXID	Utility Type	Tamper	Last Check-In (Site)
<b>Inactives</b>							
Repeater			R5: Building 20 East - 3rd floor fdc closet	30875409		Yes	
Repeater			R6: Building 20 West - 3rd floor fdc closet	30875447		Yes	
Transmitter	Building 18 & 19	18-1812		2698197483	Water-All	Yes	12/21/19 16:32:39 Eastern Standard Time
Transmitter	Building 18 & 19	19-1901		2698197389	Water-All	Yes	01/11/20 02:15:53 Eastern Standard Time
Transmitter	Building 20	20-304		2685777120	Water-All	Yes	12/18/19 13:27:01 Eastern Standard Time
Transmitter	Building 3	3-302		2698233108	Water-All	Yes	
<b>Tampers</b>							
Transmitter	Building 18 & 19	18-1804		2698197476	Water-All	Yes	01/13/20 08:43:38 Eastern Standard Time
<b>Abnormal Check Ins (Transmitters that have not checked in consecutively over a 7-day period)</b>							
NONE							
<b>Low Battery</b>							
NONE							